




FIG. 61
WIDE-MOUTH BEAM CLAMP

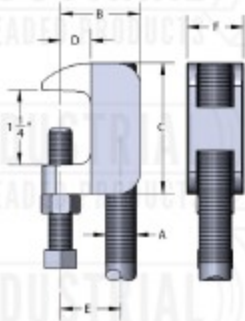

Material: Malleable iron body with hardened steel set screw.
Finish: Plain or electro-galvanized.
Service: Designed to attach hanger rod to the top flange of a beam or bar.
Approvals: U.L. - U.L.C. listed $\frac{3}{8}$ and $\frac{1}{2}$ ($\frac{1}{2}$ for 4" IPS max).
 FM approved for $\frac{3}{8}$ only. Complies with Federal Specification A-A-1192A (Type# 19) and Manufacturers' Standardization Society MSS SP-58 and SP-69 (Type# 19).
Ordering: Specify rod size, figure number and finish.
Notes: See MSS SP-69 for proper set screw torque recommendations.
 Order 61D for domestic.

ROD SIZE A	SET SCREW	B	C	D	E	F	MAX PIPE SIZE	WEIGHT EACH (lbs)	MAX REC LOAD (lbs)
$\frac{3}{8}$ -16	$\frac{3}{4}$ -10	$1\frac{1}{4}$	2	$\frac{1}{2}$	1	$\frac{7}{8}$	4	0.55	400
$\frac{1}{2}$ -13		$1\frac{1}{4}$	2	$\frac{1}{2}$	1	$\frac{7}{8}$	4	0.56	500
$\frac{5}{8}$ -11		$1\frac{1}{4}$	$2\frac{3}{8}$	$\frac{5}{8}$	$1\frac{1}{4}$	$1\frac{1}{4}$	5	0.66	850
$\frac{3}{4}$ -10		$1\frac{1}{4}$	$2\frac{3}{8}$	$\frac{5}{8}$	$1\frac{1}{4}$	$1\frac{1}{4}$	6	0.83	900

Project Information		Approval Stamp
Project:		Notes:
Address:	Contractor:	
Date:	Engineer:	
Approved <input type="checkbox"/>	Approved as Noted <input type="checkbox"/>	Not Approved <input type="checkbox"/>